A.P.C.S.

A

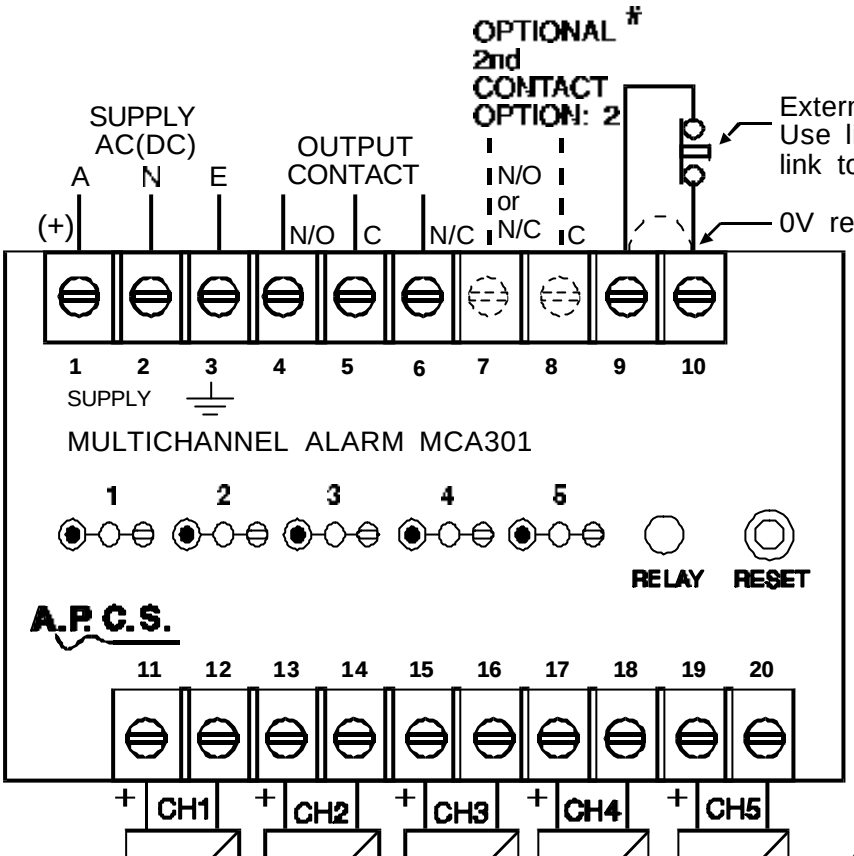

CASCADE OPERATION CANNOT BE USED WITH OPTION2, 2ndCONTACT.

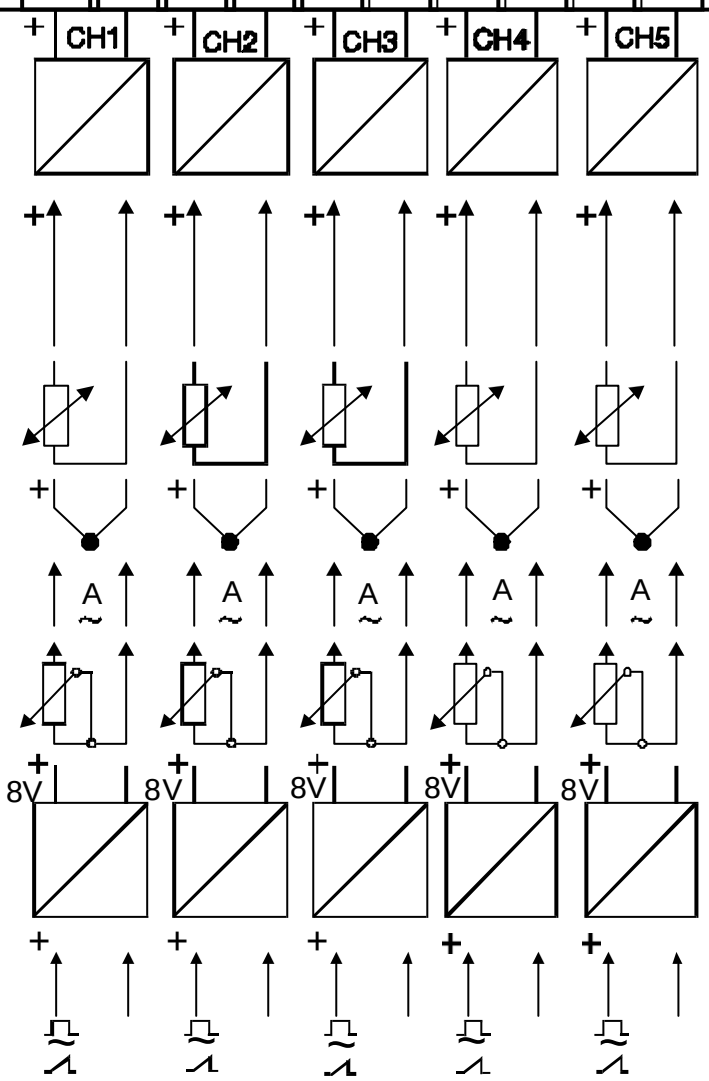

INPUTS

4-20mA LOOP POWER

2 - WIRE TRANSMITTER

HIGH LEVEL SIGNALS -
mADC
VDC
mVDC

RTD, Pt100 (2-WIRE)

THERMOCOUPLE

AC CURRENT

2-WIRE RESISTANCE
SLIDEWIRE
POTENTIOMETER

NAMUR, CONTACT

EXTERNALLY SOURCED
PULSE, SINE SIGNAL

A.P.C.S. ANALOG PROCESS CONTROL SERVICES PTY. LTD.
24 FRED STREET, LILYFIELD 2040 N.S.W., AUSTRALIA
Fax 02-9555 1055
Tel 02-9555 1044

MULTICHANNEL ALARM CONNECTION DIAGRAM 'A' | No. DS30102 Issue: 3 12/11/96